


MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR
 100/200 AMP TEMPORARY POLE INSTALLATION
 Typical Service Mast Installation

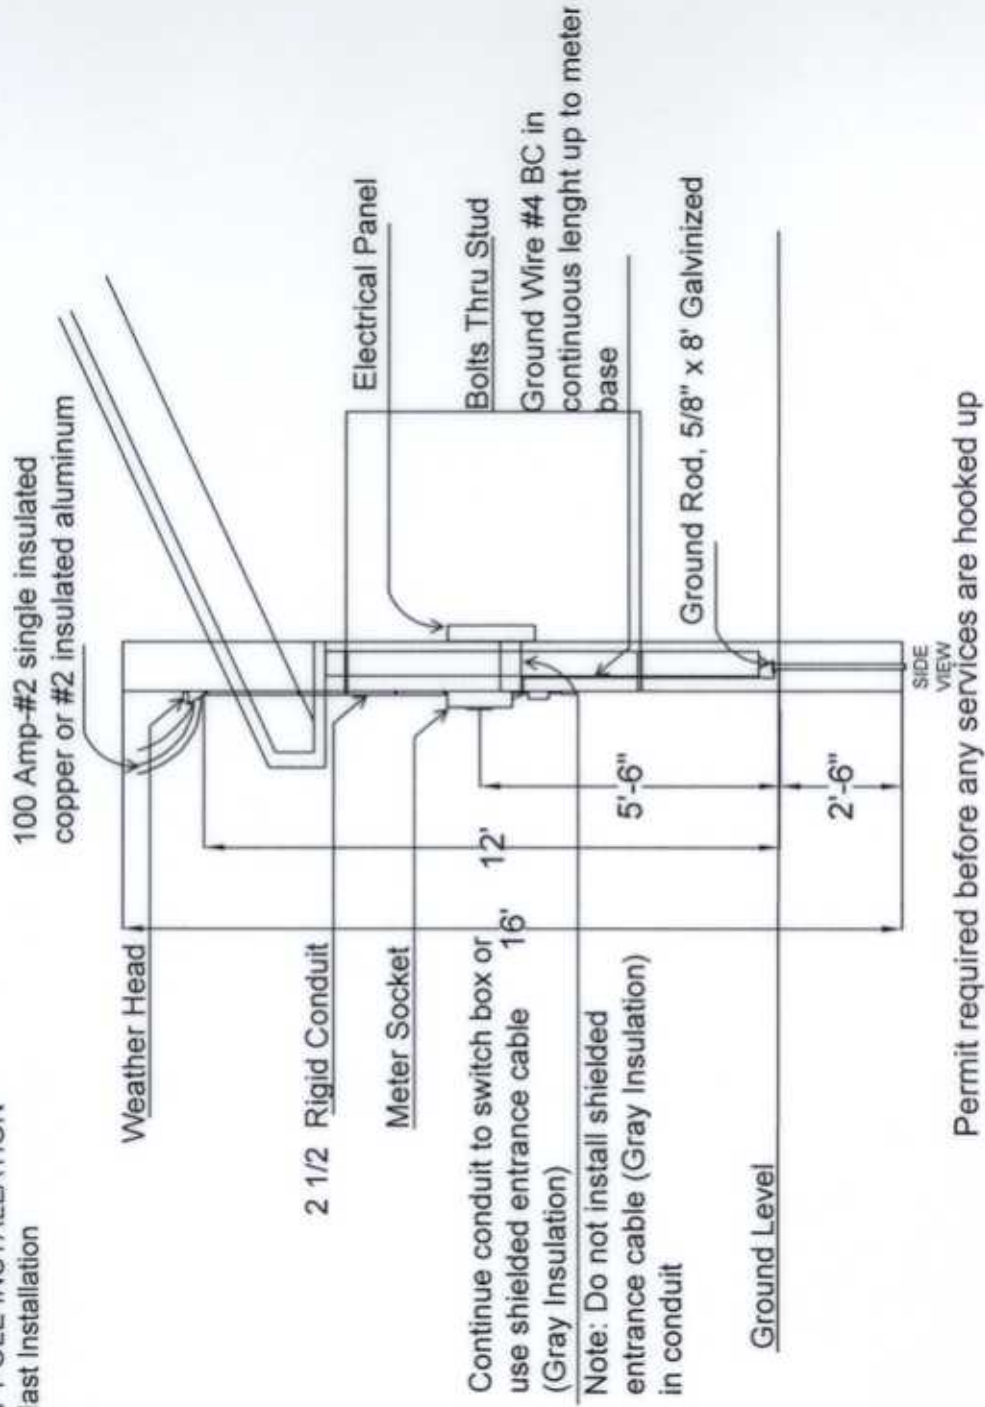

- Does the conduit for the service extend at least 3ft. above the roof
- Galvanized Conduit
- If the conduit does not extend above the roof, has an eyebolt been installed through a framing member
- If the conduit riser has a splice, does the splice occur within four feet of the meter base
- Is the meter base installed so that the wires to the weather head do not cross the roof
- Is the meter base installed at the correct height
- Use Penatrox or Oxyguard on all aluminum connections

Permit required before any services are hooked up