


MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR  
RESIDENTIAL UNDERGROUND SERVICE  
REQUIREMENTS 200 AMP

Discontinued	Copper Wire	Aluminum Wire	Conduit Size
100 Amp	#2	#2	2 1/2
200 Amp	#3/0	#4/0	3
Neutral	1/2 Size of Hotleg	1/2 Size of Hotleg	
Ground	#4 Bare Copper		

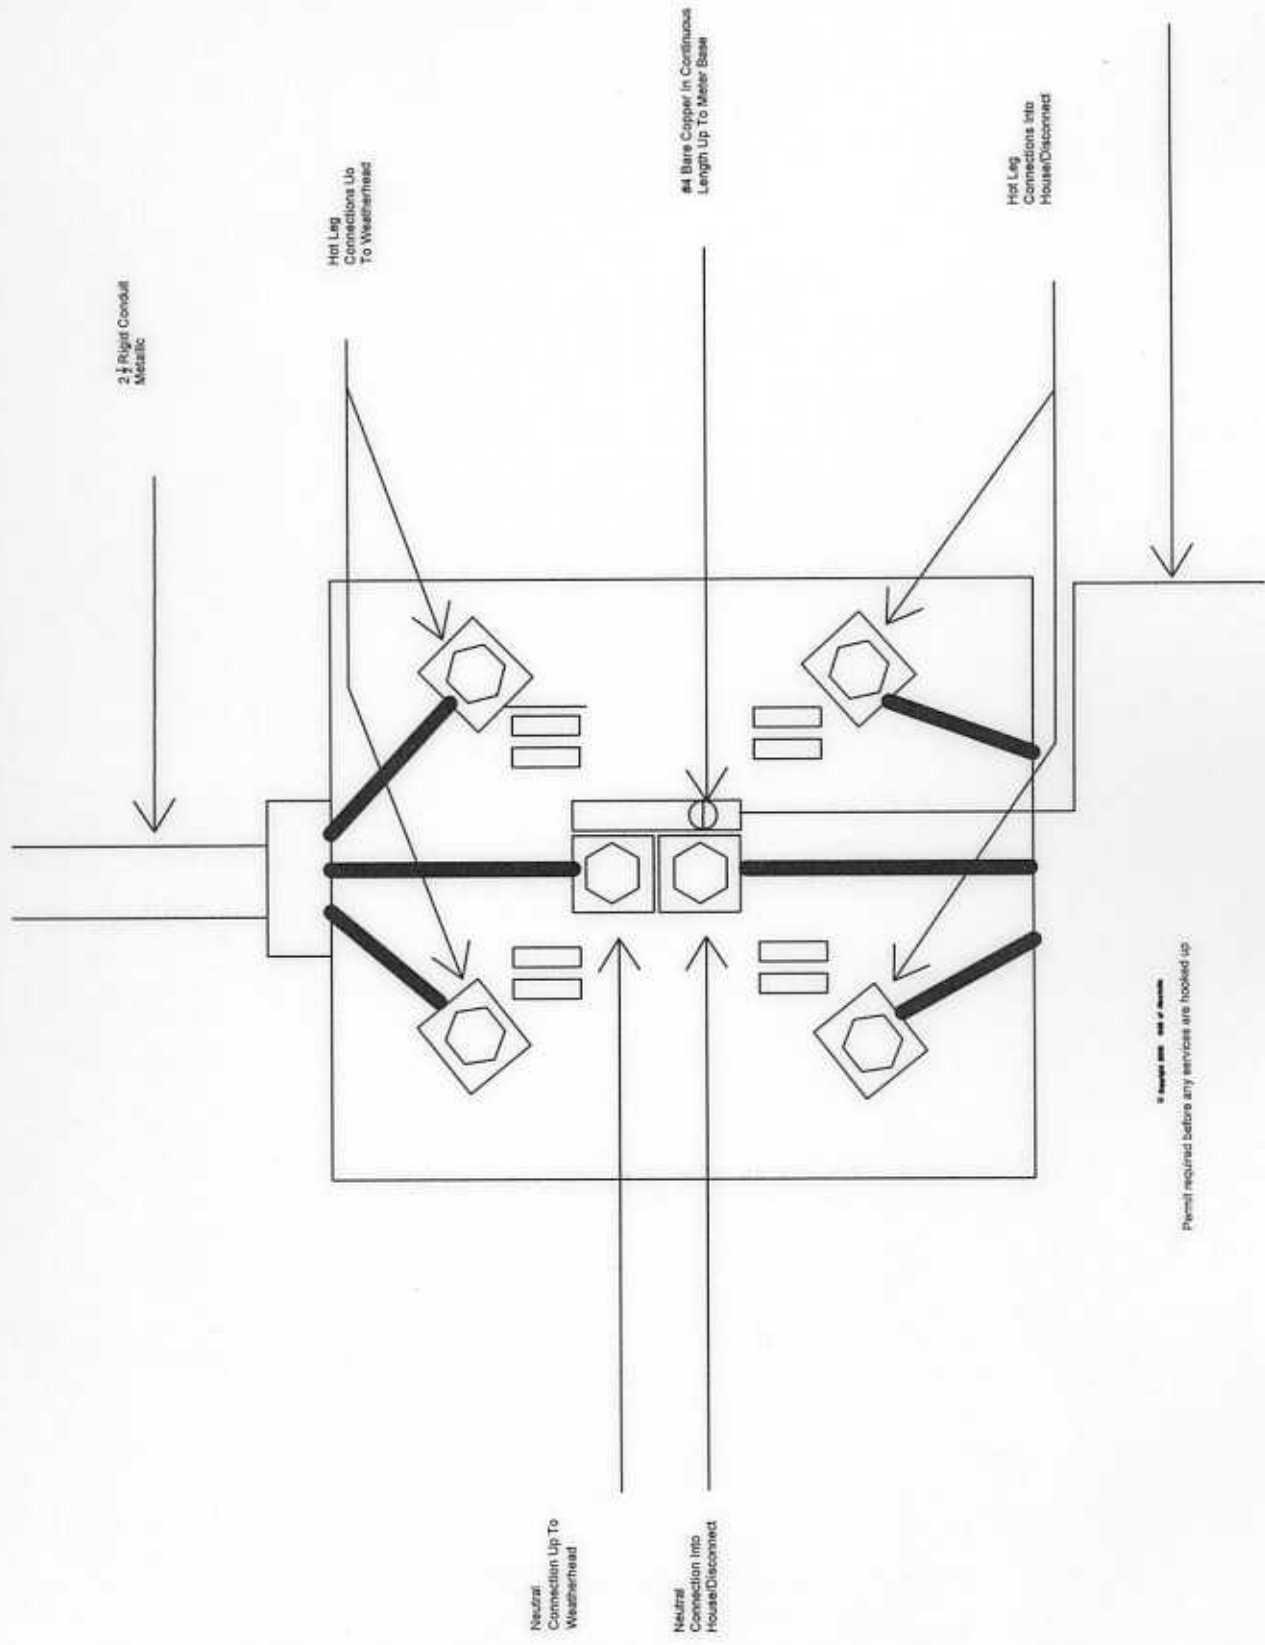

**Note #1 Use Penatrox On All Aluminum Connections**

**Note #2 Do not Install Shielded Entrance Cable in Conduit (Gray Insulation)**

**Note #3 Requires A Disconnect If Meter Base and Panel are Not Back to Back**

© Copyright 2008 City of Houston  
Permit required before any services are hooked up.