


MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR
100/200 AMP TEMPORARY POLE INSTALLATION

- Is the pole at least 16 Feet tall and at least five Inches in diameter?
- Or is the pole 16 feet and at least six by six pressure treated?
- Is the pole set at least four feet into the ground?
- Is the receptacle a ground fault interrupt type, or is it fed by a ground fault interrupt breaker?
- Are the wires from the receptacle to the disconnect run in conduit?
- Is the pole braced properly?

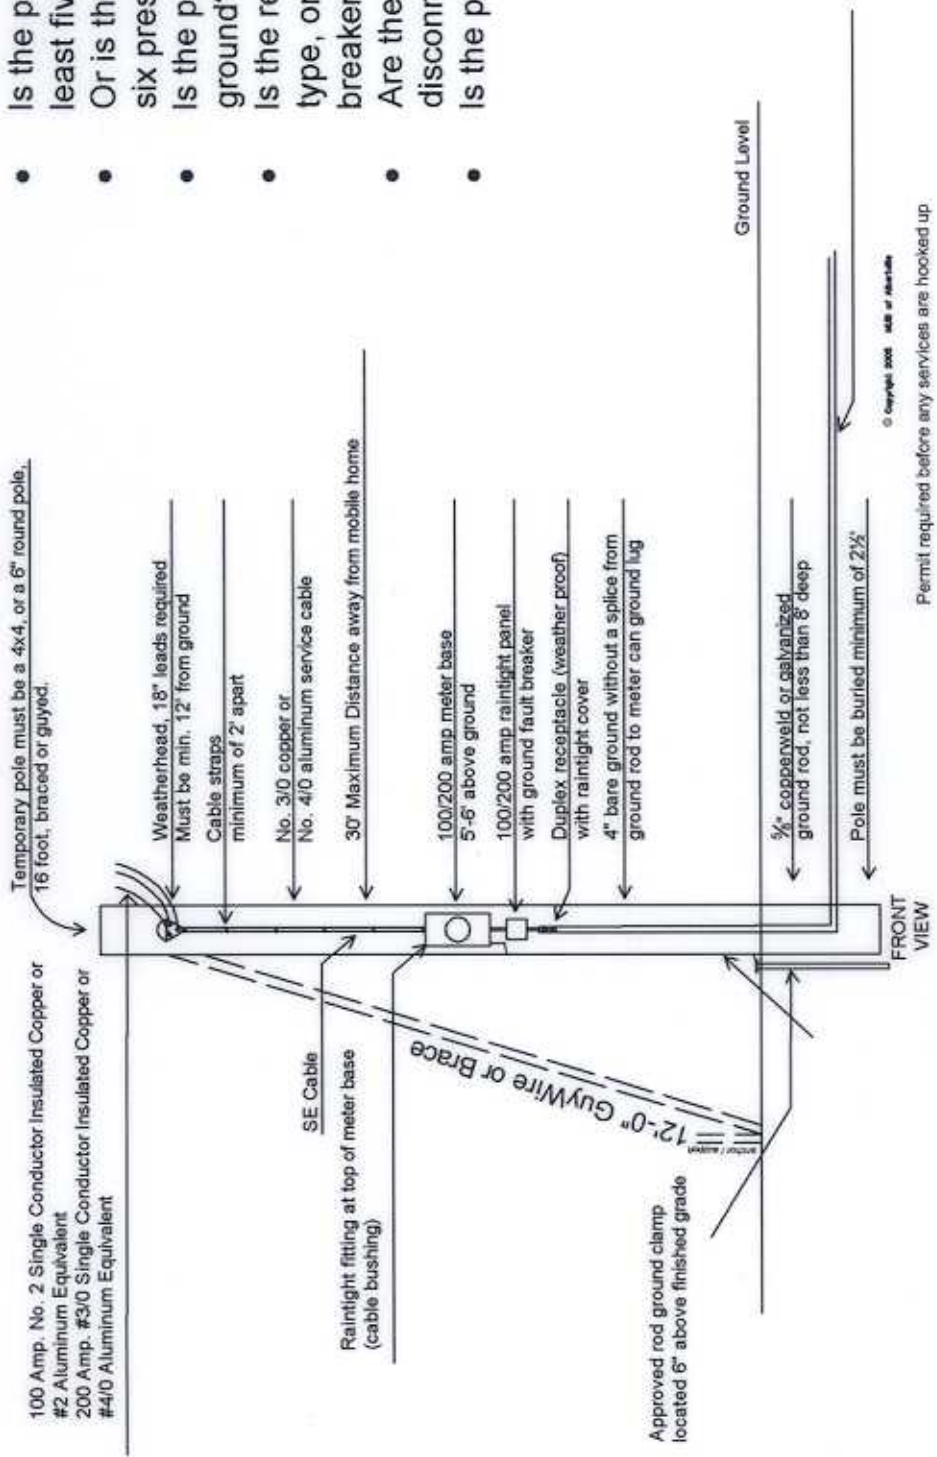

© Copyright 2005 MUB of Alameda

Permit required before any services are hooked up