


**MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR  
RESIDENTIAL UNDERGROUND SERVICE  
REQUIREMENTS 200 AMP**

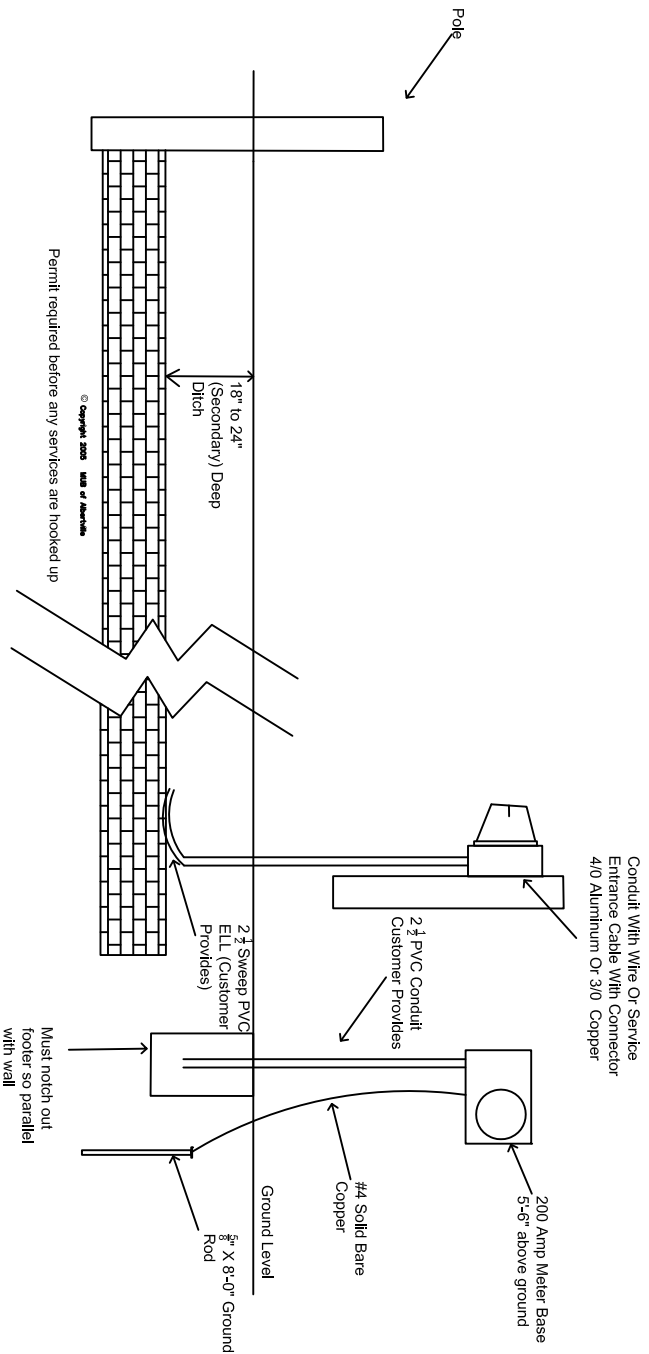

- Must Get Permit From City Hall And Turn Into MUB To Get Meter Base
- Have portions of the Foundation Beyond The Exterior Wall Removed
- Customer Must Open Ditch 18"-24" Inches In Depth
- Clear Ditch of All Obstructions: Tree Roots, Ect.
- Must Have Disconnect If Meter Base And Main Are Not Back To Back
- All Under Ground Fees Deposits And Permits Must Be Cleared Before MUB Will Turn Services On
- All Undergrounds exceeding 150FT. Will Be Charges Extra Per Ft. With Final Amount Determined By Amount Of Pipe Used
- No Services Mounded On MUB Poles Without Prior Approval By MUB In Extenuating Circumstances