


MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR  
RESIDENTIAL UNDERGROUND SERVICE  
REQUIREMENTS 200 AMP

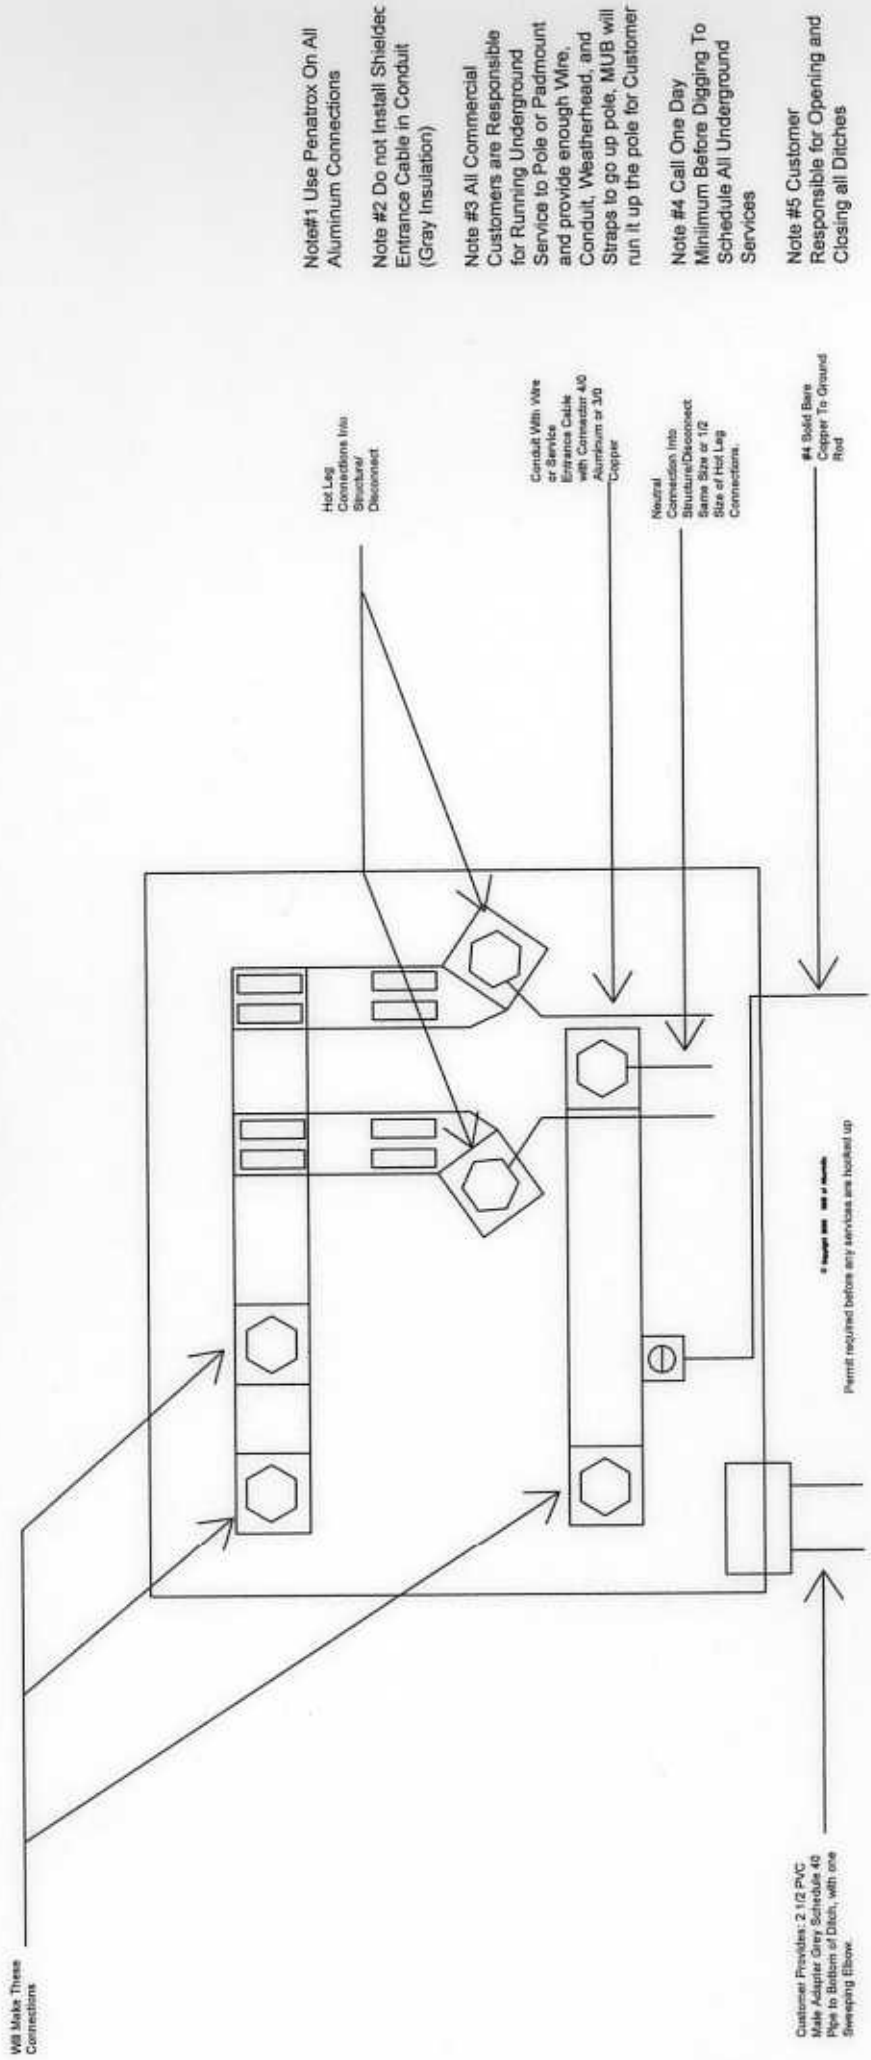

Note #1 Use Penatrox On All Aluminum Connections

Note #2 Do not Install Shielded Entrance Cable in Conduit (Gray Insulation)

Note #3 All Commercial Customers are Responsible for Running Underground Service to Pole or Padmount and provide enough Wire, Conduit, Weatherhead, and Straps to go up pole. MUB will run it up the pole for Customer

Note #4 Call One Day Minimum Before Digging To Schedule All Underground Services

Note #5 Customer Responsible for Opening and Closing all Ditches

Customer Provides 2 1/2 PVC Male Adapter and Schedule 40 Pipe to Bottom of Ditch, with one Sweeping Elbow

Permit required before any services are hooked up